


## Avitus® Bone Harvester PSIS HARVEST

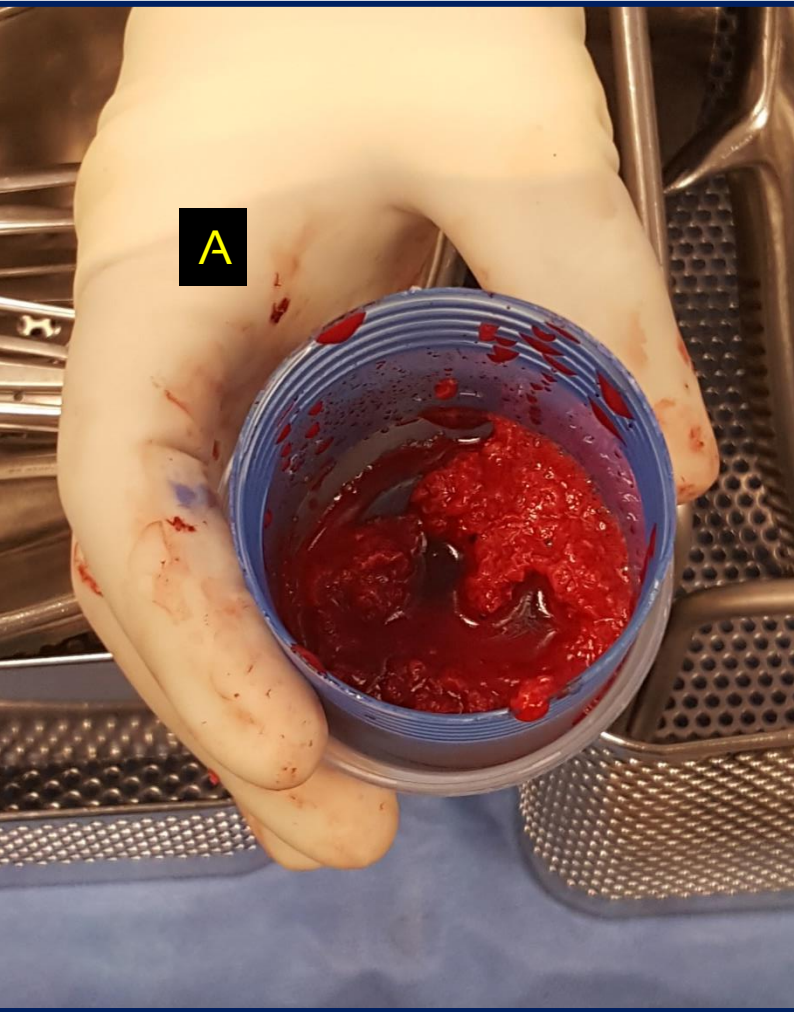

- 3 minutes harvest time
- 10 CC's gold-standard cancellous bone
- 30 CC's gold-standard bone marrow captured
- No blood loss from harvest
- Graft was used for a L5-S1 PLIF

A) Shows Avitus® gold standard Cancellous bone (marrow not shown)